

Model 375XL

Reduced Pressure Principle Assembly

Application

Ideal for use where Lead-Free* valves are required. Designed for installation on potable water lines to protect against both backsiphonage and backpressure of contaminated water into the potable water supply. Assembly shall provide protection where a potential health hazard exists.

Standards Compliance

- ASSE® Listed 1013
- IAPMO® Listed
- CSA® Certified B64.4
- AWWA compliant C511
- · Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California
- UL® Classified (less shut-off valves only, 3/4"-2")
- C-UL® Classified (less shut-off valves only, 3/4"-2")
- Meets the requirements of NSF/ANSI 61*
- *(0.25% MAX. WEIGHTED AVERAGE LEAD CONTENT)

Materials

Reinforced Nylon, FDA approved Housing Stainless Steel, 300 Series **Fasteners** Elastomers Silicone (FDA Approved) Buna Nitrile (FDA Approved)

Delrin, Nylon Internals

Springs Stainless Steel, 300 series


Ball Valves Low Lead Cast Bronze, ASTM B 584

Struts Stainless Steel, 300 Series

Features

1/2", 3/4", 1", 1-1/4", 1-1/2", 2" Sizes:

Maximum working water pressure 175 PSI Maximum working water temperature 180°F Hydrostatic test pressure 350 PSI End connections Threaded FNPT ANSI B1.20.1

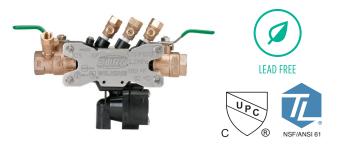

Options

(Suffixes can be combined)

- П with full port QT ball valves (standard)
- \square S with Model SXL lead-free bronze "Y" type strainer
- □ FT with integral male 45° flare SAE test fitting
- □ AG with air gap
- □ SAG with Model SXL lead-free bronze "Y" strainer
 - and air gap
- □В - with black fusion epoxy coated ball valves &


struts for theft protection


Accessories

- ☐ Repair kits
- Thermal expansion tank (Mdl. XT)
- Soft seated check valve (Mdl. 40XL2) Shock arrester (Model 1260XL)
- ☐ QT-SET Quick Test Fitting Set
- ☐ Blow out / Flush fitting (RK34-375BOF (1/2" or 3/4"),

RK1-375BOF or RK114-350-375BOF)

MODELS 375XLSE





Dimensions & Weights (do not include pkg.)

			DIMENSIONS (approximate)																		
MODEL 375XL SIZE		А		В		С		D		E		F		G		н		J		WEIGHT	
in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg
1/2	20	8 7/8	225	1 15/16	49	1 3/8	35	2 15/16	75	3 7/8	98	12 1/4	311	3	76	10 7/8	276	12 1/4	311	5.7	2.6
3/4	20	8 7/8	225	1 15/16	49	1 3/8	35	2 15/16	75	3 7/8	98	12 5/8	321	3	76	11	279	12 1/4	311	5.7	2.6
1	25	11 3/16	284	2 1/4	57	1 13/16	46	3 7/16	87	4	102	14 9/16	370	4	102	13 3/4	349	15 1/4	387	9.7	4.4
1-1/4	32	14 7/8	378	3 3/8	86	3 1/8	80	3 3/4	95	5 3/4	146	20 1/2	521	3 3/4	95	18	457	18 1/2	470	20.5	9.3
1-1/2	40	15 1/4	387	3 3/8	86	3 1/8	80	3 3/4	95	5 3/4	146	22	559	4 1/2	114	18 3/4	476	20 1/4	514	21.5	9.8
2	50	16	406	3 3/8	86	3 1/8	80	3 3/4	95	5 3/4	146	24	610	4 3/4	120.7	20 3/4	527	20 3/4	527	23.5	10.7

Zurn Industries, LLC | Wilkins

1747 Commerce Way, Paso Robles, CA U.S.A. 93446 Ph. 855-663-9876, Fax 805-238-5766


In Canada | Zurn Industries Limited

7900 Goreway Drive, Unit 10, Brampton, Ontario L6T 5W6, 877-892-5216


www.zurn.com

Date: 12/19 Document No. BF-375XL Patent No. 6, 513, 543, 7,784,483, & 7,905,250 Product No. Model 375XL

MODEL 375XL 1/2" - 1" (STANDARD & METRIC)

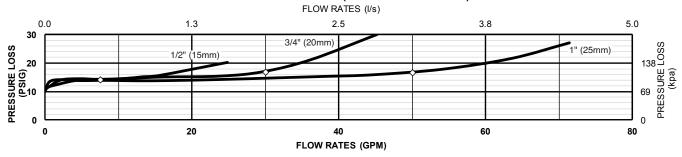


MODEL 375XL 1-1/4" - 2" (STANDARD & METRIC)

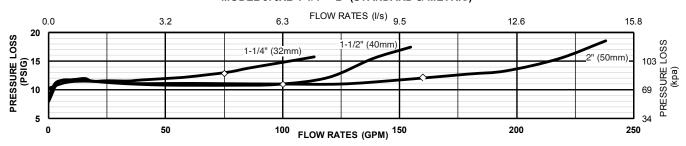



Typical Installation

Local codes shall govern installation requirements. To be installed in accordance with the manufacturers' instructions and the latest edition of the Uniform Plumbing Code. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. The installation shall be made so that no part of the unit can be submerged.

Relief Valve Discharge Rates

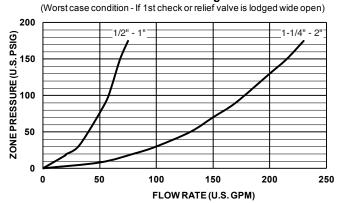

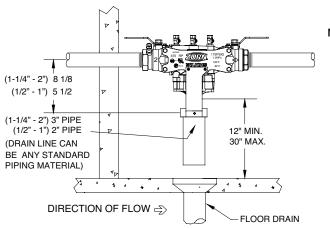

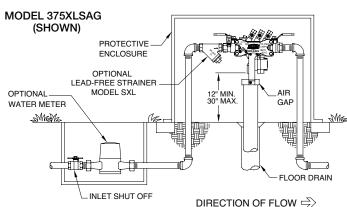

INDOOR INSTALLATION

OUTDOOR INSTALLATION

Specifications

The Reduced Pressure Principle Backflow Preventer shall be certified to NSF/ANSI 61, ASSE® Listed 1013, rated to 180°F, and supplied with full port ball valves. The main body shall be Nylon and the seat disc elastomers shall be silicone. If installed indoors, the installation shall be supplied with an air gap adapter. The Reduced Pressure Principle Backflow Preventer shall be a ZURN WILKINS Model 375XL.